

VICONIC HEALTH ACOUSTICAL PERFORMANCE TEST REPORT

SCOPE OF WORK

ASTM E90 AND ASTM E492 TESTING ON 5.5 MM CARPET TILE OVER 11 MM VICONIC SAFETY FLOORING™ UNDERLAYMENT

SPECIMEN TYPE

Open Web Truss - 457 mm

REPORT NUMBER

N6747.08-113-11-R0

TEST DATE

05/03/22

ISSUE DATE

05/06/22

RECORD RETENTION END

05/03/26


PAGES

15

DOCUMENT CONTROL

RTTDS-R-AMER-Test-2844 (03/23/22)

© 2017 INTERTEK

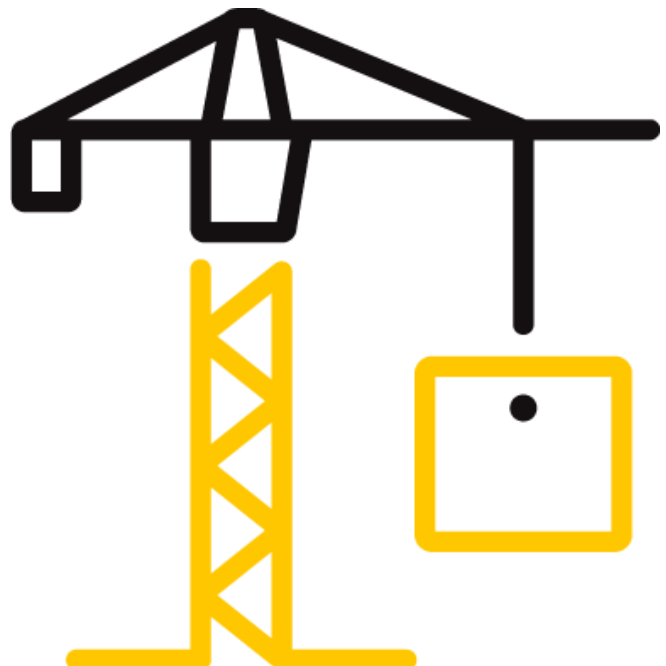

TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0

Date: 05/06/22

REPORT ISSUED TO

VICONIC HEALTH

1100 Oakwood Boulevard

Dearborn, Michigan 48124

SECTION 1

SCOPE

Architectural Testing, Inc. (an Intertek company) dba Intertek Building & Construction (B&C) was contracted by Viconic Health to perform testing in accordance with ASTM E90 AND ASTM E492 on 5.5 mm Carpet Tile over 11 mm VICONIC SAFETY FLOORING™ Underlayment. Results obtained are tested values and were secured by using the designated test methods. Testing was conducted in the VT test chambers at Intertek B&C located in York, Pennsylvania.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

SECTION 2

SUMMARY OF TEST RESULTS

DATA FILE NO.	N6747.04
SERIES/MODEL:	5.5 mm Carpet Tile over 11 mm VICONIC SAFETY FLOORING™ Underlayment
STC	57
IIC	56
HIIC	75

COMPLETED BY: Morgan S. J. Kennedy
Technician - Acoustical
TITLE: Testing
SIGNATURE:
DATE: 05/06/22

COMPLETED BY: Daniel B. Mohler
Project Lead - Acoustical
TITLE: Testing
SIGNATURE:
DATE: 05/06/22

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.



TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0

Date: 05/06/22

SECTION 3

TEST METHODS

The specimen was evaluated in accordance with the following:

ASTM E90-09 (2016), *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions*

ASTM E413-16, *Classification for Rating Sound Insulation*

ASTM E492-09(2016)e1, *Standard Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine*

ASTM E989-21, *Classification for Determination of Impact Insulation Class (IIC)*

ASTM E2235-04 (2020), *Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods*

ASTM E3222-20, *Standard Classification for Determination of High-Frequency Impact Sound Ratings*

SECTION 4

MATERIAL SOURCE/INSTALLATION

The full test specimen was assembled on the day of testing by B&C. All materials provided by the client were installed on an existing B&C assembly (Open Web Truss - 457 mm) utilizing B&C-supplied materials. The assembly was installed in a steel test frame which was installed into the opening between the source and receive rooms in the test chamber. The test frame was isolated from the structure with dense neoprene gasket.

The total weight of the floor/ceiling assembly was 875.4 kg. B&C will store samples of the test specimen for four years. Photographs of the test specimen are included in the report. A drawing of the test specimen is included in the report.

B&C will service this report for the entire test record retention period. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained by B&C for the entire test record retention period.

Unless differently required, Intertek reports apply the "Simple Acceptance" rule, also called "Shared Risk approach," of ILAC-G8:09/2019, Guidelines on Decision Rules and Statements of Conformity.

TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0

Date: 05/06/22

SECTION 5 EQUIPMENT

INSTRUMENT	MANUFACTURER	MODEL	DESCRIPTION	ASSET #	CAL DATE	
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02572	05/21	*
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02574	05/21	*
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02575	05/21	*
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02576	05/21	*
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02577	05/21	*
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02578	05/21	*
2-Channel Analog Output	National Instruments	NI 9260	2-Channel Analog Input	INT02573	05/21	*
Microphone Calibrator	Norsonic	34093	Acoustical Calibrator	65105	10/21	
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	63745	09/21	
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63747	07/21	
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	64340	10/21	
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63744	09/21	
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	65968	01/22	
Receive Room Environmental Indicator	Comet	T7510	Temperature and Humidity Transmitter	63810	10/21	
				63811	10/21	
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	65103	02/22	
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	64902	12/21	
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	63741	07/21	
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	63742	04/22	
Source Room Microphone	PCB Electronics	378C20	Microphone and Preamplifier	64906	04/22	
Source Room Environmental Indicator	Comet	T7510	Temperature and Humidity Transmitter	63812	10/21	
Tapping Machine	Norsonic	Nor277	Tapping Machine	INT00936	02/22	

* The calibration frequency for this equipment is every two years per the manufacturer's recommendation.

VT RECEIVE ROOM VOLUME	155.77 m ³
VT SOURCE ROOM VOLUME	190 m ³

SECTION 6 LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Morgan S. J. Kennedy	Intertek B&C
Daniel B. Mohler	Intertek B&C

TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0

Date: 05/06/22

SECTION 7

TEST PROCEDURE

The microphones were calibrated before conducting the tests. The air temperature and relative humidity conditions were monitored and recorded during all measurements. The average temperature and humidity of both the source and receive rooms are listed in Sections 10 and 11. The maximum and minimum temperatures and humidities of the receive room from the duration of the test are listed in Sections 12 and 13.

The airborne transmission loss test was conducted in accordance with the ASTM E90 test method using the single direction method. Two background noise sound pressure level and five sound absorption measurements were conducted at each of five microphone positions. Two sound pressure level measurements were made simultaneously in both rooms, at each of five microphone positions.

The impact sound transmission test was conducted in accordance with the ASTM E492 test method. Two background noise sound pressure level, two sound pressure level measurements with the tapping machine operating at each position specified by ASTM E492, and five sound absorption measurements were conducted at each of five microphone positions.

The details of this construction are noted as proprietary per the customer's request. Reference should be made to Intertek-ATI Report N6747.04-113-11 for detailed information on the specific construction.

Detailed test procedures, data for flanking limit tests, repeatability measurements, and reference specimen tests are available upon request.

SECTION 8

TEST CALCULATIONS

The STC (Sound Transmission Class), IIC (Impact Insulation Class), and HIIC (High-Frequency Impact Insulation Class) ratings were calculated in accordance with ASTM E413, ASTM E989, and ASTM E3222, respectively.

TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0

Date: 05/06/22

SECTION 9

TEST SPECIMEN DESCRIPTION

MATERIAL	DIMENSIONS (mm)	THICKNESS (mm)	MANUFACTURER AND SERIES	QUANTITY	AVERAGE WEIGHT
Carpet Tile	914.4 by 228.6	5.5	N/A	10.98 m ²	3.08 kg/m ²
	Note: Adhered to the underlayment with the manufacturer's adhesive using a 0.79 mm by 1.59 mm by 0.79 mm trowel. Adhesive was allowed to cure per manufacturer's specifications.				
Underlayment	774.7 by 1524	11.0	VICONIC SAFETY FLOORING™	10.98 m ²	2.1 kg/m ²
	Note: Loose laid				
Gypsum Concrete	3022.6 by 3632.2	19.1	N/A	10.98 m ²	36.62 kg/m ²
	Note: Poured directly onto the subfloor underlayment, cured a minimum of 14 days. The gypsum panel had a closed cell foam perimeter isolation. No noticeable shrinkage or cracking was visible on the specimen.				
Oriented Strand Board Sheathing	1219 by 2438	18.8	N/A	10.98 m ²	11.67 kg/m ²
	Note: Adhered to the floor trusses with Loctite PL 400 Subfloor adhesive. Fastened with 9D nails on 203 mm centers along perimeter and 305 mm centers along trusses.				
Fiberglass Insulation	520.7 by 3023	88.9	R-13	10.98 m ²	1.32 kg/m ²
	Note: Installed in the cavity between trusses, stapled flush with the subfloor				
Open Web Truss	88.9 by 2933.7	457.2	N/A	7 trusses	19.05 kg/truss
	Note: Installed on 610 mm centers using JUS414 hanger brackets.				
Resilient Channel	68.6 by 3454.4	12.7	ClarkDietrich RC Deluxe™	31.05 lin m	0.33 kg/m
	Note: Installed on 305 mm centers perpendicular to the trusses. The measured thickness of the metal was 0.7 mm.				
Gypsum Panel	1219 by 3023	15.9	Type C	10.98 m ²	11.91 kg/m ²
	Note: Fastened to the channels on 305 mm centers with 25.4 mm Type S bugle head screws. The seams of the gypsum panels were sealed with Pecora AC-20 FTR caulk and covered with pressure sensitive tape.				

TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0

Date: 05/06/22

SECTION 10

TEST RESULTS - AIRBORNE SOUND TRANSMISSION LOSS



TEST DATE	5/3/2022				
DATA FILE NO.	N6747.04				
CLIENT	Viconic Health				
DESCRIPTION	5.5 mm Carpet Tile, 11 mm VICONIC SAFETY FLOORING™ Underlayment, 19.1 mm Gypsum Concrete, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm R-13 Fiberglass Insulation, 457.2 mm Open Web Truss, 12.7 mm ClarkDietrich RC Deluxe™ Resilient Channel, 15.9 mm Type C Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Receive Temp.	16.1°C	Source Temp.	17.6°C
TECHNICIAN	MSJK	Receive Humidity	70%	Source Humidity	70%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION m ²	SOURCE SPL (dB)	RECEIVE SPL (dB)	SPECIMEN TL (dB)	95% SAMPLING LIMIT	NUMBER OF DEFICIENCIES
50	36	22.8	105	75	28	4.4	-
63	35.4	16.8	103	72	30	4.9	-
80	35.5	14.9	100	70	29	2.7	-
100	26.5	8.2	98	64	37	2.8	-
125	24.7	10.4	101	61	41	2.3	0
160	24.0	9.2	98	57	42	1.7	2
200	21.0	9.5	94	51	45	0.8	2
250	17.6	9.4	96	50	49	1.3	1
315	18.1	9.0	99	52	48	0.9	5
400	19.0	8.1	99	49	52	0.7	4
500	20.1	7.5	96	44	53	0.5	4
630	20.7	7.1	97	44	55	0.7	3
800	21.0	7.5	95	41	56	0.6	3
1000	21.8	7.4	96	38	59	0.6	1
1250	20.2	7.4	95	33	65	0.6	0
1600	19.4	7.6	96	31	67	0.4	0
2000	15.0	8.5	95	30	67	0.4	0
2500	13.3	9.4	91	25	68	0.7	0
3150	16.1	10.1	90	18	73	0.9	0
4000	10.3	11.2	90	16	75	0.6	0
5000	9.9	12.7	88	11	78	0.8	-
6300	8.8	15.8	85	8	76	1.1	-
8000	9.2	20.3	85	8	75	1.1	-
10000	9.4	20.3	84	8	74	1.6	-
STC Rating	57	(Sound Transmission Class)			Sum of Deficiencies	25	

- Notes:
- 1) Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.
 - 2) Specimen TL levels listed in red are potentially limited by the laboratory flanking limit.
 - 3) Specimen TL levels listed in blue indicate the lower limit of the transmission loss.
 - 4) Specimen TL levels listed in green indicate that there has been a filler wall correction applied

TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0


Date: 05/06/22

SECTION 11

TEST RESULTS - AIRBORNE SOUND TRANSMISSION LOSS GRAPH



TEST DATE	5/3/2022				
DATA FILE NO.	N6747.04				
CLIENT	Viconic Health				
DESCRIPTION	5.5 mm Carpet Tile, 11 mm VICONIC SAFETY FLOORING™ Underlayment, 19.1 mm Gypsum Concrete, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm R-13 Fiberglass Insulation, 457.2 mm Open Web Truss, 12.7 mm ClarkDietrich RC Deluxe™ Resilient Channel, 15.9 mm Type C Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Receive Temp.	16.1°C	Source Temp.	17.6°C
TECHNICIAN	MSJK	Receive Humidity	70%	Source Humidity	70%

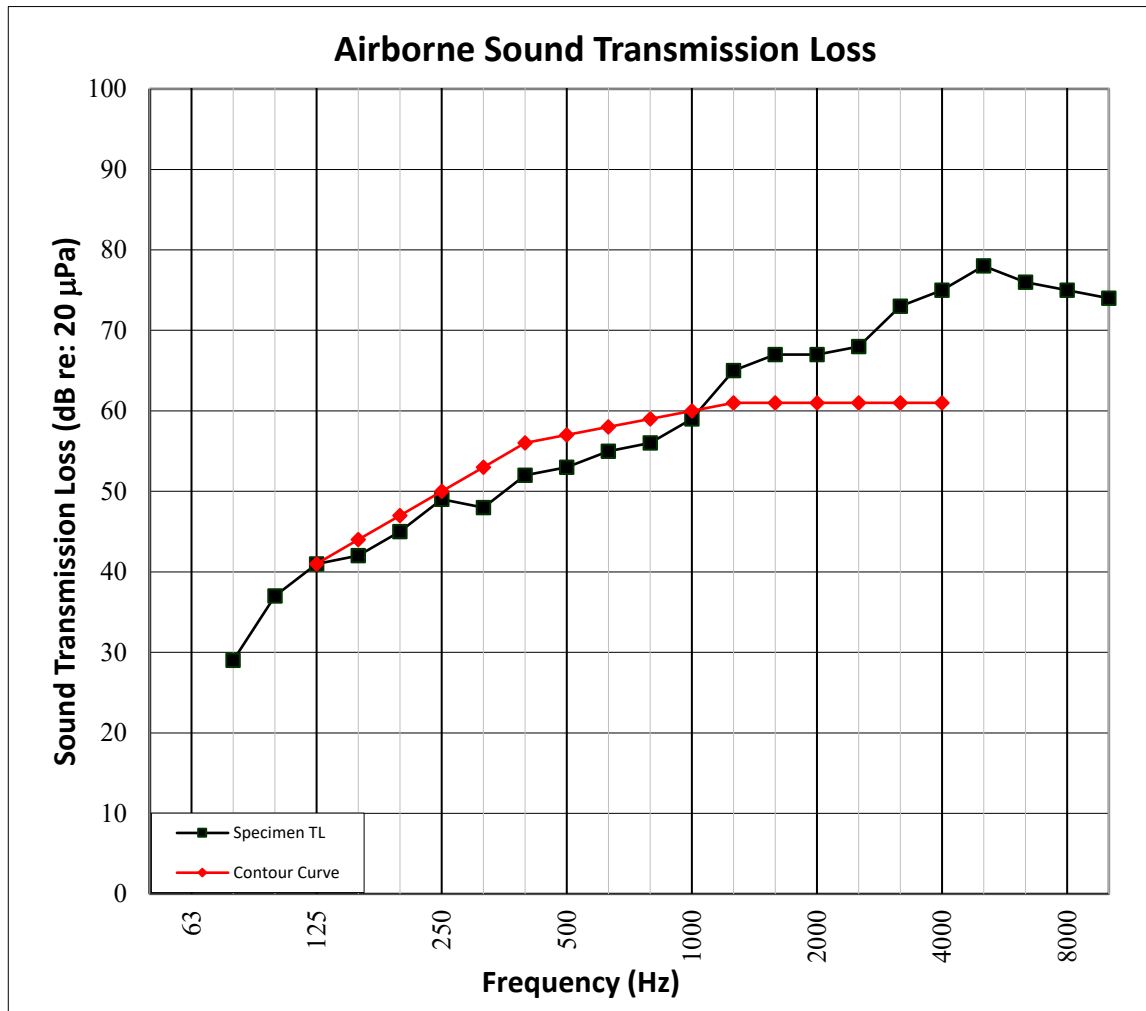

TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0

Date: 05/06/22

SECTION 12

TEST RESULTS - IMPACT SOUND TRANSMISSION



TEST DATE	5/3/2022				
DATA FILE NO.	N6747.04				
CLIENT	Viconic Health				
DESCRIPTION	5.5 mm Carpet Tile, 11 mm VICONIC SAFETY FLOORING™ Underlayment, 19.1 mm Gypsum Concrete, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm R-13 Fiberglass Insulation, 457.2 mm Open Web Truss, 12.7 mm ClarkDietrich RC Deluxe™ Resilient Channel, 15.9 mm Type C Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Maximum Temp.	16.1°C	Minimum Temp.	16.1°C
TECHNICIAN	MSJK	Max. Humidity	70%	Min. Humidity	70%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION m ²	NORMALIZED IMPACT SPL (dB)	95% SAMPLING LIMIT	NUMBER OF DEFICIENCIES
80	38.9	16.6	70	1.8	-
100	32.0	8.6	63	1.1	7
125	24.8	10.3	64	0.5	8
160	25.1	9.5	63	1.0	7
200	20.5	9.8	61	0.8	5
250	16.5	9.2	55	0.8	0
315	21.9	8.8	50	0.6	0
400	18.6	7.9	44	0.7	0
500	20.1	7.2	38	0.5	0
630	21.0	7.1	33	0.4	0
800	19.2	7.4	29	0.4	0
1000	20.4	7.3	29	0.7	0
1250	18.7	7.4	28	0.8	0
1600	15.5	7.5	24	0.6	0
2000	12.7	8.5	25	0.6	0
2500	13.1	9.4	24	0.4	0
3150	12.4	10.2	20	0.9	0
4000	10.6	11.1	15	1.3	-
5000	11.1	12.8	13	1.6	-
6300	9.9	15.8	10	1.3	-
8000	9.6	20.2	11	1.2	-
10000	9.5	20.2	11	1.1	-
IIC Rating	56	(Impact Insulation Class)		Sum of Deficiencies	27

Notes: Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.

TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0


Date: 05/06/22

SECTION 13

TEST RESULTS - IMPACT SOUND TRANSMISSION GRAPH



TEST DATE	5/3/2022				
DATA FILE NO.	N6747.04				
CLIENT	Viconic Health				
DESCRIPTION	5.5 mm Carpet Tile, 11 mm VICONIC SAFETY FLOORING™ Underlayment, 19.1 mm Gypsum Concrete, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm R-13 Fiberglass Insulation, 457.2 mm Open Web Truss, 12.7 mm ClarkDietrich RC Deluxe™ Resilient Channel, 15.9 mm Type C Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Maximum Temp.	16.1°C	Minimum Temp.	16.1°C
TECHNICIAN	MSJK	Max. Humidity	70%	Min. Humidity	70%

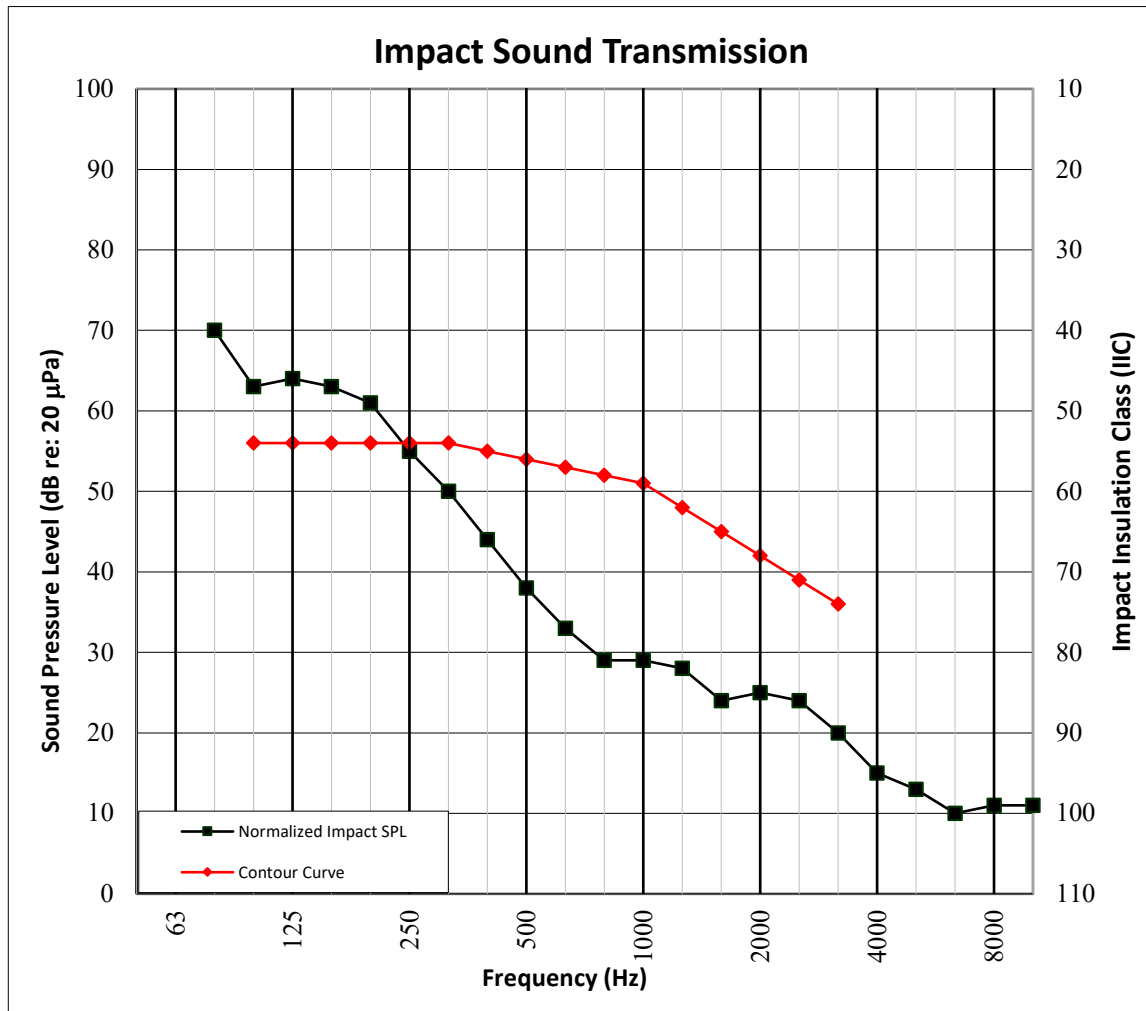

TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0

Date: 05/06/22

SECTION 14

TEST RESULTS - HIGH-FREQUENCY IMPACT SOUND TRANSMISSION



TEST DATE	5/3/2022				
DATA FILE NO.	N6747.04				
CLIENT	Viconic Health				
DESCRIPTION	5.5 mm Carpet Tile, 11 mm VICONIC SAFETY FLOORING™ Underlayment, 19.1 mm Gypsum Concrete, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm R-13 Fiberglass Insulation, 457.2 mm Open Web Truss, 12.7 mm ClarkDietrich RC Deluxe™ Resilient Channel, 15.9 mm Type C Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Maximum Temp.	16.1°C	Minimum Temp.	16.1°C
TECHNICIAN	MSJK	Max. Humidity	70%	Min. Humidity	70%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION m ²	NORMALIZED IMPACT SPL (dB)	95% SAMPLE CONFIDENCE LIMIT	NUMBER OF DEFICIENCIES
400	18.6	7.9	44	0.7	7.7
500	20.1	7.2	38	0.5	3.2
630	21.0	7.1	33	0.4	0.0
800	19.2	7.4	29	0.4	0.0
1000	20.4	7.3	29	0.7	0.0
1250	18.7	7.4	28	0.8	0.0
1600	15.5	7.5	24	0.6	0.0
2000	12.7	8.5	25	0.6	2.0
2500	13.1	9.4	24	0.4	3.7
3150	12.4	10.2	20	0.9	3.0
HIIC Rating	75	(High-Frequency Impact Insulation Class)		Sum of Deficiencies	19.6

Notes: Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.

TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0


Date: 05/06/22

SECTION 15

TEST RESULTS - HIGH-FREQUENCY IMPACT SOUND TRANSMISSION GRAPH



TEST DATE	5/3/2022				
DATA FILE NO.	N6747.04				
CLIENT	Viconic Health				
DESCRIPTION	5.5 mm Carpet Tile, 11 mm VICONIC SAFETY FLOORING™ Underlayment, 19.1 mm Gypsum Concrete, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm R-13 Fiberglass Insulation, 457.2 mm Open Web Truss, 12.7 mm ClarkDietrich RC Deluxe™ Resilient Channel, 15.9 mm Type C Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Maximum Temp.	16.1°C	Minimum Temp.	16.1°C
TECHNICIAN	MSJK	Max. Humidity	70%	Min. Humidity	70%

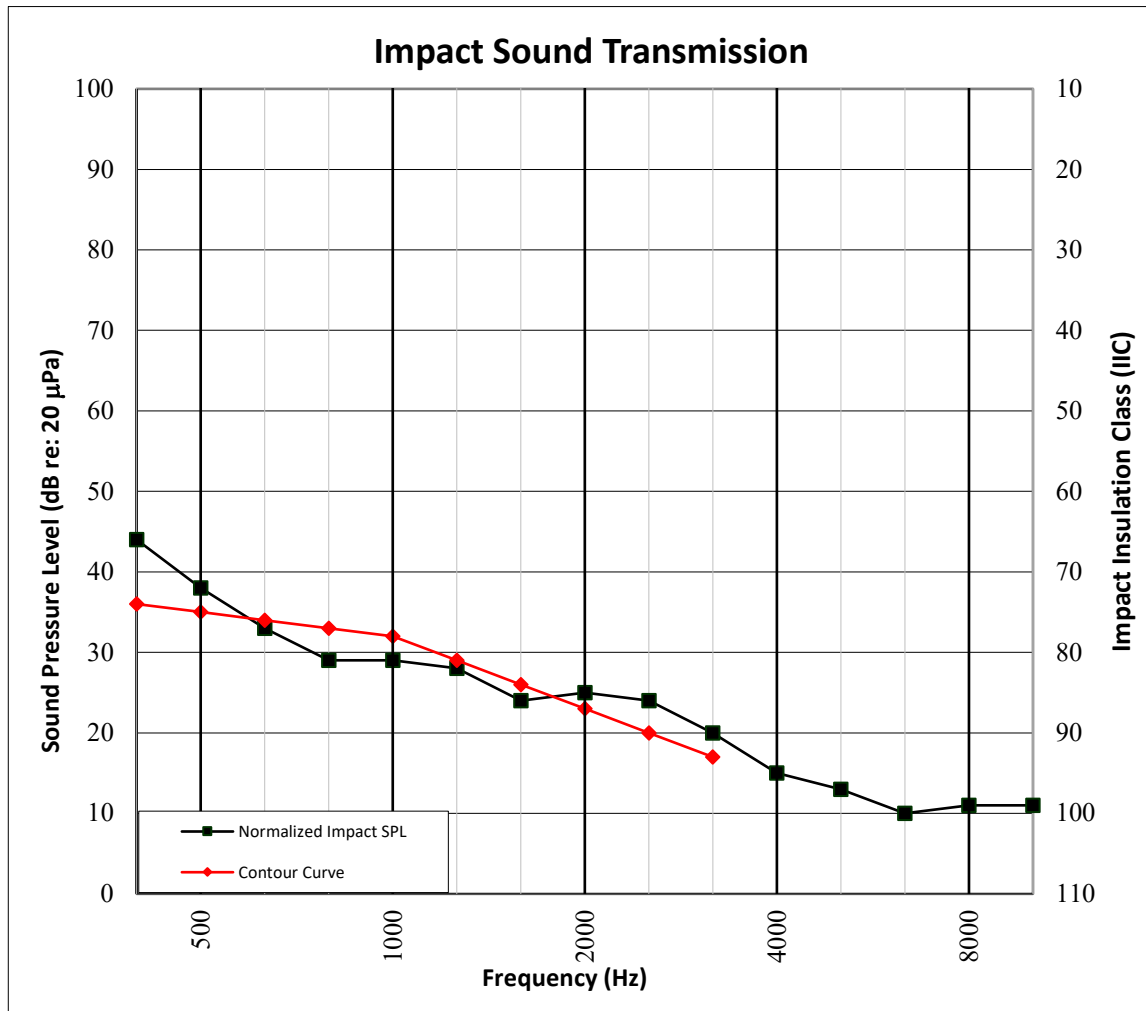

TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0

Date: 05/06/22

SECTION 16

PHOTOGRAPHS



Photo No. 1

Source Room View of Test Specimen Installation



Photo No. 2

Receive Room View of Test Specimen Installation


TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0

Date: 05/06/22

SECTION 17

DRAWING

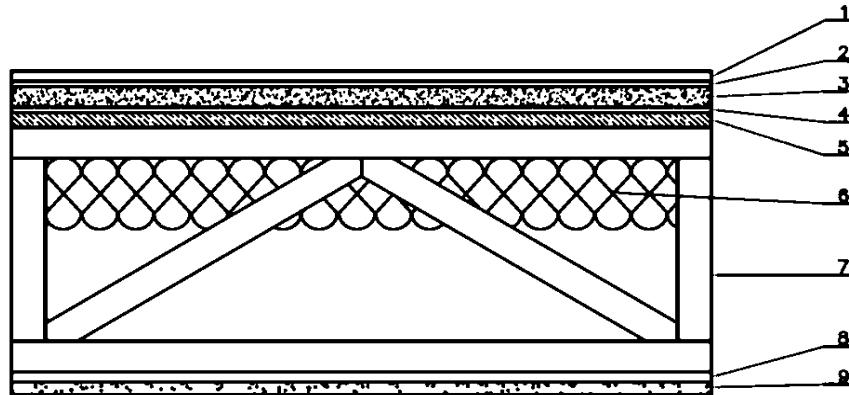

- 1-Floor Topping
- 2-Underlayment
- 3-Subfloor Topping
- 4-Subfloor Underlayment
- 5-Subfloor
- 6-Insulation
- 7-Truss
- 8-Ceiling Isolation
- 9-Ceiling



Total Quality. Assured.

130 Derry Court
York, PA 17406

Telephone: 717-764-7700
Facsimile: 717-764-4129
www.intertek.com/building

TEST REPORT FOR VICONIC HEALTH

Report No.: N6747.08-113-11-R0

Date: 05/06/22

SECTION 18

REVISION LOG

REVISION #	DATE	PAGES	DESCRIPTION
R0	05/06/22	N/A	Original Report Issue